

DFAPP: Ethernet Gateway for **Domino** bus

DFAPP module is a gateway between the Ethernet network and the **Domino** bus; through BDTools and BDWizard support programs, it is possible to perform all usual operations such as the assignment of module addresses, the programming of the system functions, reading and editing of operating programs, updating firmware of modules and more yet through the Ethernet network, both locally and remotely. Having an access point properly configured, these operations can be performed in wireless mode.

DFAPP module also allows to control the home automation system through applications iCasaMia and ACasaMia available for free on the related stores; thanks to this last possibility, DFAPP module is a user-friendly solution for the control and management, both locally and remotely, of lighting, automation, air conditioning, scheduled operations, loads control, energy consumption, and more again.



DFAPP module allows to manage most of the variables of the **Domino** bus, specifically:

- digital inputs status
- status and command of real outputs
- value of analog inputs (eg. temperature)
- setting of analogue outputs (eg. dimmer)
- status and command of virtual points
- management of scheduled times

As said above, through DFAPP module it is possible to program **Domino** modules, both locally and remotely, as well as update their firmware. DFAPP module is open to future developments, being itself completely upgradeable.

Some LEDs visible from the panel provides an indication of the operating status of the module as described in the following table:

LED	Color	Function
POLL	Green	It flashes one time per second to indicate that the module is active
VAR	Green	It flashes in case of change of state of a Domino digital input module
BUS F.	Red	Fixed On when Domino bus failure occurs (if DFAPP is separately powered)
MOD F.	Red	On for 5s when a module does not answer to a message
TX	Yellow	It flashes when the communication is active
RX	Red	It flashes when the communication is active


DFAPP module features a terminal block for the connection to the **Domino** bus, from which it derives the power necessary for its operation.



It is however possible to supply the module from an auxiliary power supply in order to save current for the bus modules. No more connections are required, except the Ethernet connection to a hub/router. DFAPP module is housed in a DIN 4M box for rail mounting.

Module connection

The following schematic diagram shows the connections required by DFAPP module.

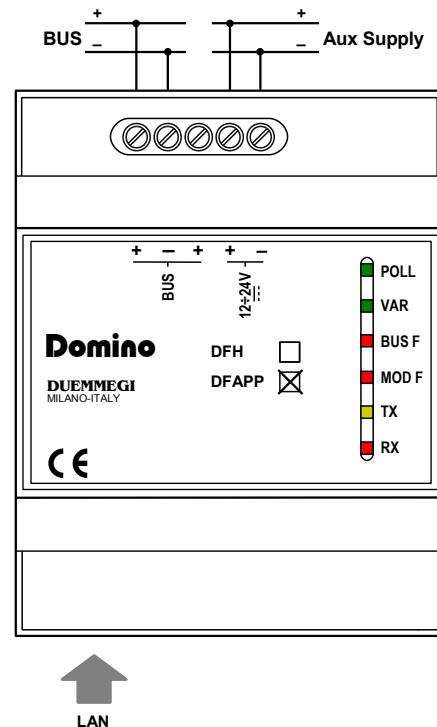

As shown in this schematic diagram, DFAPP module must be connected to a dc power supply in the range 12 to 24V, to the **Domino** bus and to the Ethernet network.

If the total amount of installed **Domino** modules and DFPW2 power supplies allow this, it is possible to supply DFAPP module directly by the bus. The possibility to use this last method essentially depends on:

- the number of DFPW2 power supplies installed in the system
- the number of modules installed in the system
- the bus extension

As known, a single DFPW2 module, in a **Domino** system, can supply up to 50 “generic” modules about (in other words the classics input and output modules of the **Domino** family).


DFAPP module has a “weight”, from the point of view of the current consumption, equal to 20 “generic” modules. For instance, in a plant with a DFAPP and a single DFPW2 power supply, it will be possible to install as maximum:

50 modules – 20 modules = 30 generic **Domino** modules

If more modules have to be installed, then more DFPW2 modules are required.


Take in account that this rule does not consider the length of the bus, the section of the cable used for the bus and the location of DFPW2 modules. Remember that DFPW2 module features a LED reporting the overload condition; for details refer to the technical sheet of DFPW2 module.

To supply DFAPP module by the bus, execute the connections shown in the following schematic diagram.

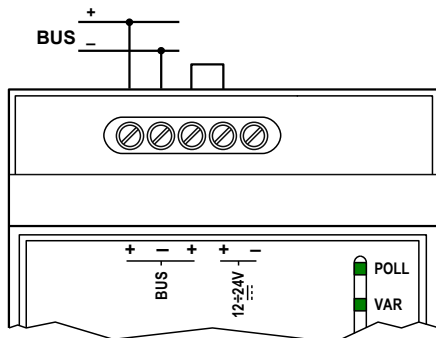

Setting up

DFAPP module has an IP address DFAPP factory set to 192.168.1.251 port 1002. To change these network parameters, BDTtools support program version 8.2.2 or higher is required. From the main menu, select Programming, Modules Configuration, DFAPP; the following window will be shown:

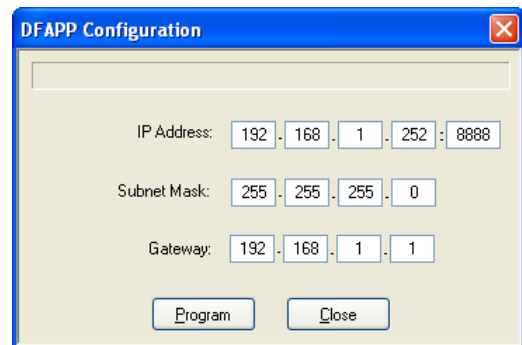


Enter the desired parameters and then push Program button.

Technical characteristics

Power supply	12 ÷ 24V $\overline{\text{SELV}}$ or by Domino bus (weight: 20 standard modules)
Current consumption	Equal to 20 standard modules
MAX current consumption	160mA @ 12V $\overline{\text{SELV}}$ 90mA @ 24V $\overline{\text{SELV}}$
CPU	Raspberry Pi 2 Model B with CPU quad-core Cortex-A7 Broadcom BCM2836 900MHz ARM
RAM	1GB
SSD	Micro SD industrial-grade SLC 4GB
Available interfaces	4 USB 1 Ethernet 10/100Mbps
Housing	DIN standard 4M for rail mounting
Operating temperature	0 ÷ +50 °C
Storage temperature	-20 ÷ +70 °C
Protection degree	IP20

Outline dimensions

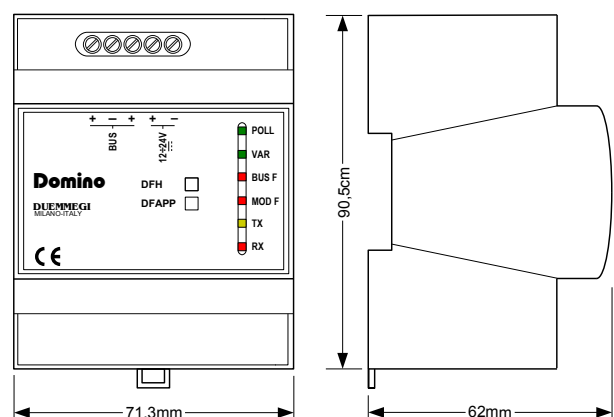

Correct disposal of this product



(Waste Electrical & Electronic Equipment)
(Applicable in the European Union and other European countries with separate collection systems). This marking on the product, accessories or literature indicates that the product should not be disposed of with other household waste at the end of their working life. To prevent possible harm to

the environment or human health from uncontrolled waste disposal, please separate these items from other types of waste and recycle them responsibly to promote the sustainable reuse of material resources. Household users should contact either the retailer where they purchased this product, or their local government office, for details of where and how they can take these items for environmentally safe recycling. This product and its electronic accessories should not be mixed with other commercial wastes for disposal.

Installation and use restrictions

Standards and regulations

The design and the setting up of electrical systems must be performed according to the relevant standards, guidelines, specifications and regulations of the relevant country. The installation, configuration and programming of the devices must be carried out by trained personnel.

The installation and the wiring of the bus line and the related devices must be performed according to the recommendations of the manufacturers (reported on the specific data sheet of the product) and according to the applicable standards.

All the relevant safety regulations, e.g. accident prevention regulations, law on technical work equipment, must also be observed.

Safety instructions

Protect the unit against moisture, dirt and any kind of damage during transport, storage and operation. Do not operate the unit outside the specified technical data.

Never open the housing. If not otherwise specified, install in closed housing (e.g. distribution cabinet). Earth the unit at the terminals provided, if existing, for this purpose. Do not obstruct cooling of the units. Keep out of the reach of children.

Setting up

The physical address assignment and the setting of parameters (if any) must be performed by the specific softwares provided together the device or by the specific programmer. For the first installation of the device proceed according to the following guidelines:

- Check that any voltage supplying the plant has been removed
- Assign the address to module (if any)
- Install and wire the device according to the schematic diagrams on the specific data sheet of the product
- Only then switch on the 230Vac supplying the bus power supply and the other related circuits

Applied standards

This device complies with the essential requirements of the following directives:

- 2004/108/CE (EMC)
- 2006/95/CE (Low Voltage)
- 2002/95/CE (RoHS)

Note

Technical characteristics and this data sheet are subject to change without notice.